


ANALISA PENGGUNAAN


CANSELORI & HEP

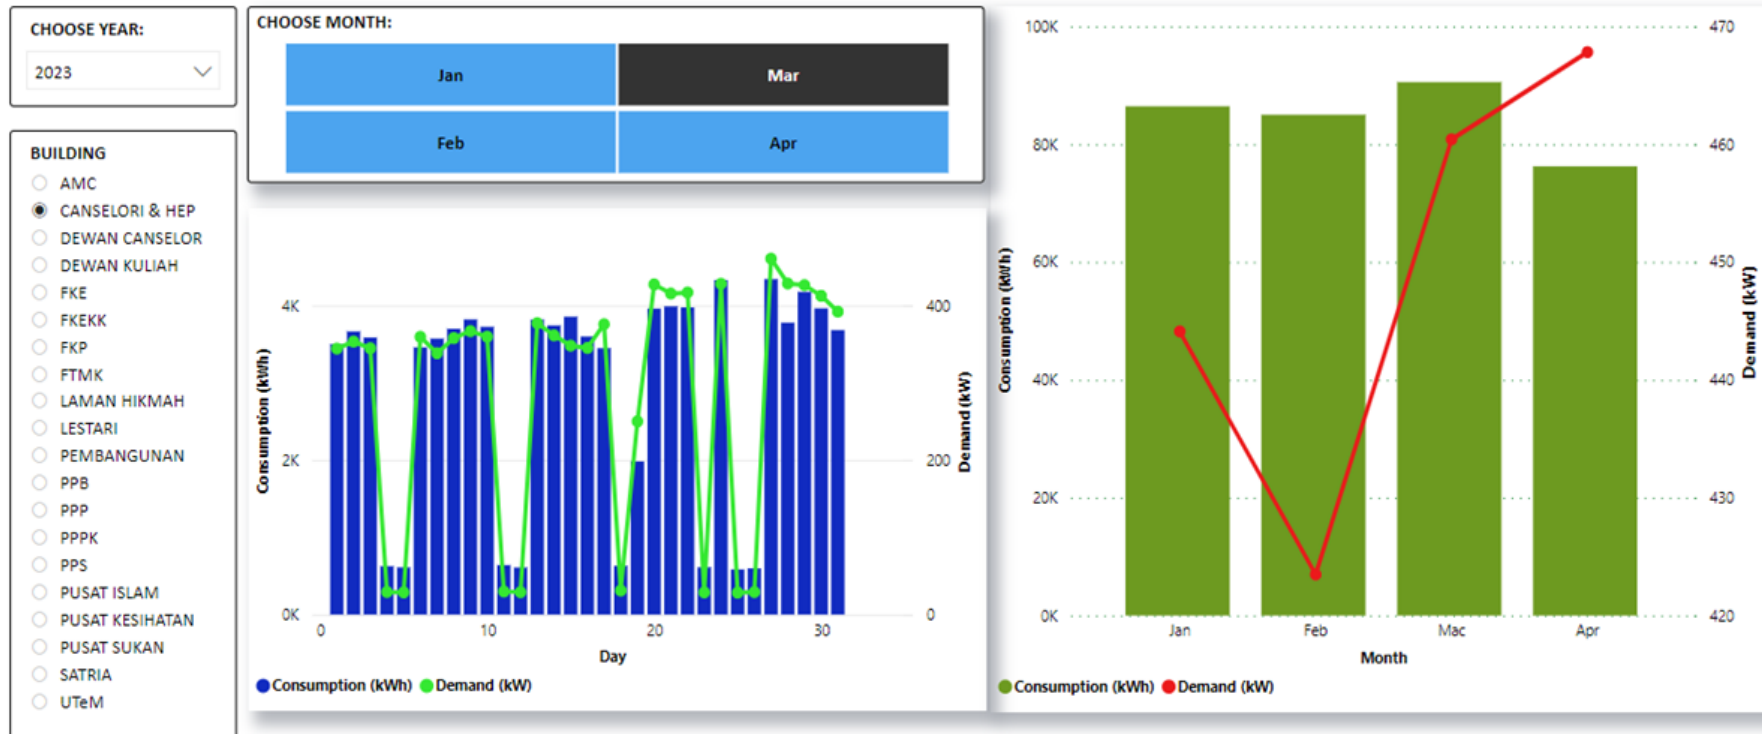

MONTHLY					YEARLY	
SEER	CO ₂ EMISSION(Tonnes)	LOAD FACTOR INDEX	PEAK DEMAND (kW)	CONSUMPTION (kWh)	BEI (kWh/Year/m ²)	CO ₂ EMISSION(Tonnes)
9.42	57.95	0.27	460.41	90,540.00	35.18	216.45

ANALISA KOS ASAS

CANSELORI & HEP

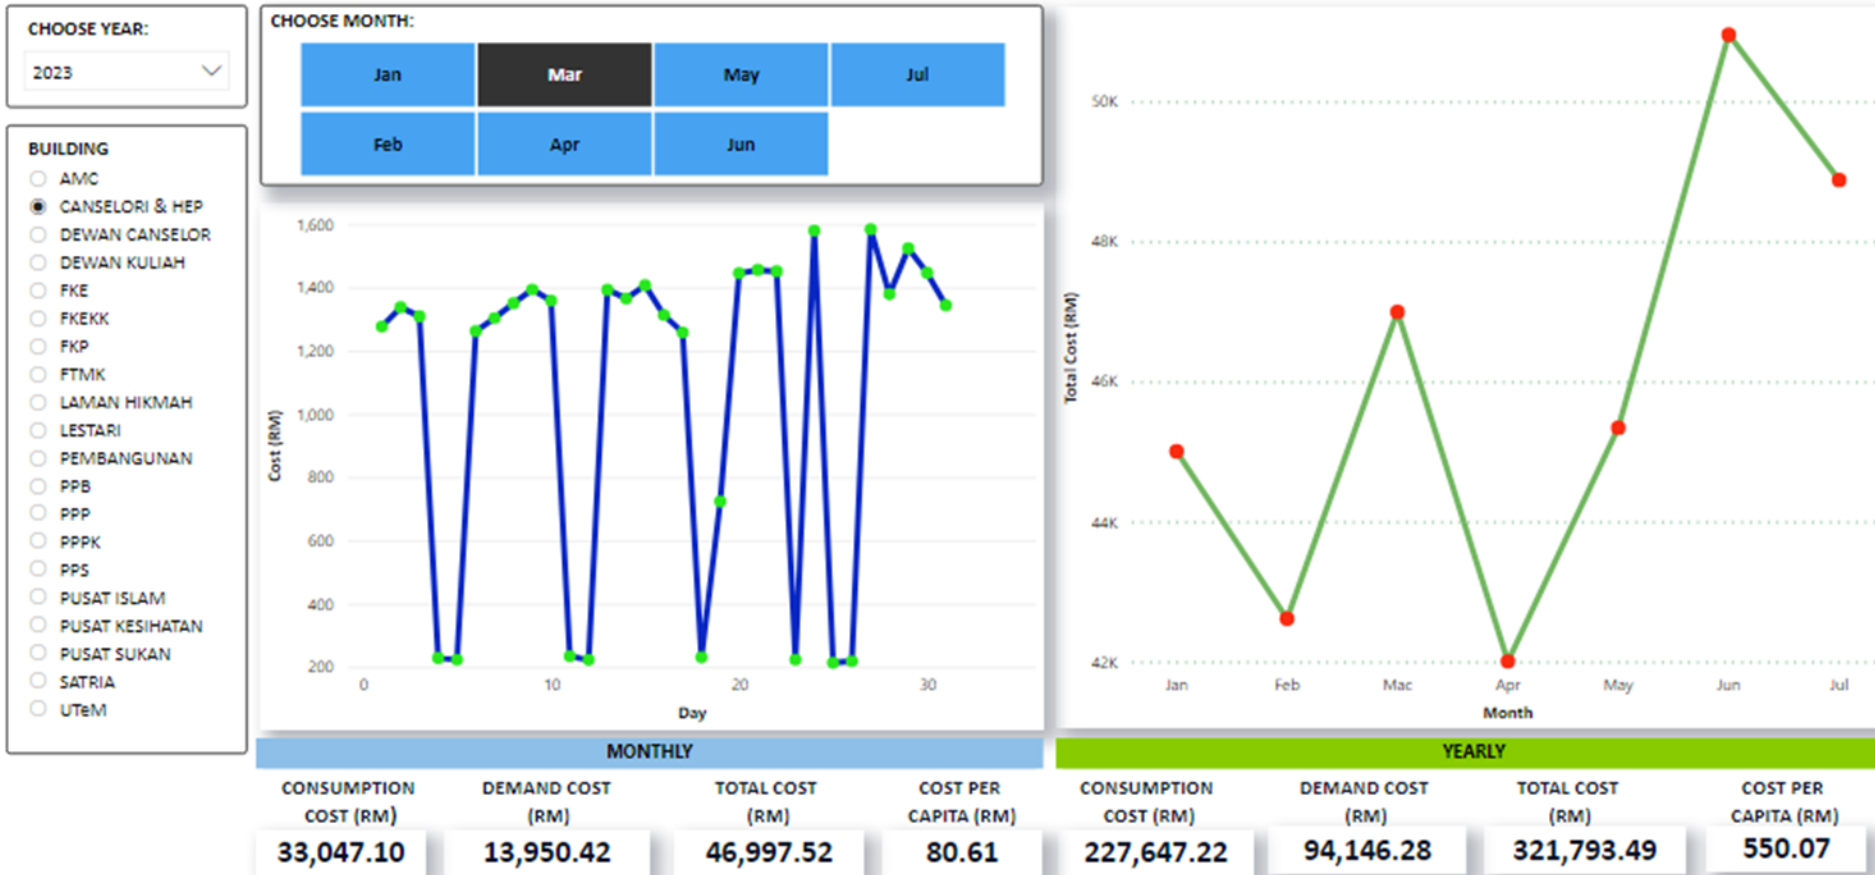

ANALISA PERBANDINGAN

CHOOSE YEAR:

2023 ▾

CHOOSE MONTH:

Jan

Feb

Mar


Apr

May

Jun

Jul

CONSUMPTION BY BUILDING

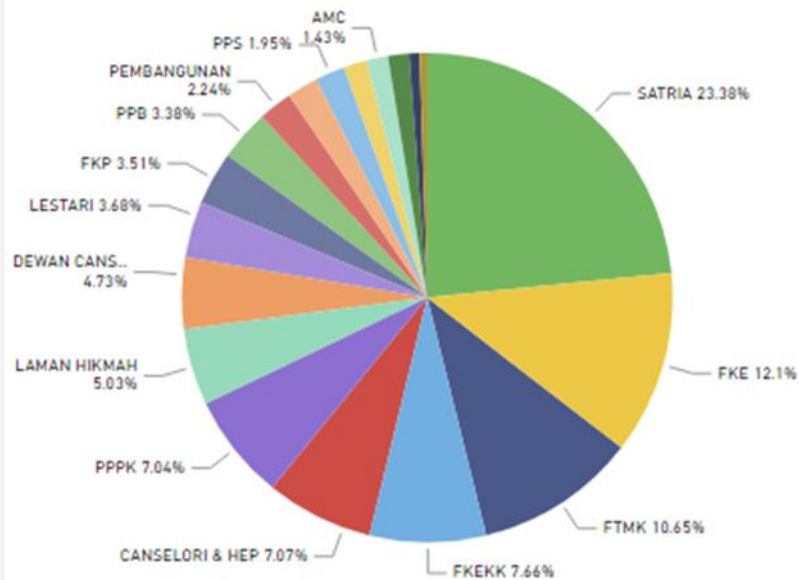

POWER DEMAND PROFILE FOR LOAD FACTOR IMPROVEMENT



LOAD FACTOR BEFORE

0.64

LOAD FACTOR AFTER

0.66

SIMULATION COST SAVING (RM)

30,906.54